



- ELECTRICAL EQUIPMENT IDENTIFICATION**
- ① "DP-2", 125V DC DISTR. PNL.
 - ② "ELP", EMERG. LTG. PNL.
 - ③ "DC-LC", DC LIGHTING CONTACTOR
 - ④ EMERGENCY OIL PUMP DC STARTER
 - ⑤ RELAY/TIMER PNL.
 - ⑥ "DP-1" 125 V DC DISTR. PNL.
 - ⑦ "UPSP 1", 120V AC ESSENTIAL PNL.
 - ⑧ TRANSF. T20, 1 ϕ , 10KVA, 480-120 V
 - ⑨ UPS-1 (INVERTER)
 - ⑩ TRANSF. T6, 3 ϕ , 30KVA, 480-480/277V
 - ⑪ LP1A-480/277V, LIGHTING PNL.
 - ⑫ TRANSF. T8, 3 ϕ , 30 KVA, 480-480/277V
 - ⑬ LP1B-480/277V, LIGHTING PNL.
 - ⑭ TRANSF. T10, 3 ϕ , 15 KVA, 480-208/120V
 - ⑮ RPIA-208/120V, RECEPTACLE PNL.
 - ⑯ TRANSF. T12, 3 ϕ , 15 KVA, 480-208/120V
 - ⑰ RPIB-208/120V, RECEPTACLE PNL.
 - ⑱ TRANSF. T4, 3 ϕ , 15 KVA, 480-208/120V
 - ⑲ MPP-1, 208/120V, MISC. POWER PNL.
 - ⑳ TRANSF. T5, 3 ϕ , 15 KVA, 480-208/120V
 - ㉑ MPP-2, 208/120V, MISC. POWER PNL.
 - ㉒ PDC-9, 480V, POWER DISTRIBUTION CENTER.
 - ㉓ OUTDOOR LIGHT CONTR. STA. "1A"
 - ㉔ OUTDOOR LIGHT CONTR. STA. "1B"

REVISIONS	
A	ISSUED FOR CLIENT REVIEW # COMMENTS: 70% COMPLETE 10-16-87
B	ISSUED FOR O.R. COMMENTS: 90% COMPLETE 1-15-88
C	REVISED ELECTRICAL EQUIP. & BATTERY ROOMS, ISSUED FOR CLIENTS COMMENTS 95% COMPLETE 1/13/88
D	ISSUED FOR CONSTRUCTION! DWN: N.M.T. 1/23/88 CHKD: T.M.A. 2/11/88 APPD: D.J.A. 2/11/88
E	12-6-87 WAS 12-8-87 17-6 WAS 17-8 WAS 18-8 WAS 18-8
F	ADDED ACCUMULATOR TANK @ C4 D 5. ADD WALLS & DOOR @ EL. 125'-0"
G	DWN: -AC 2-16-89 CHKD: N.M.T. 2/17/89 APPD: D.J.A. 2/20/89

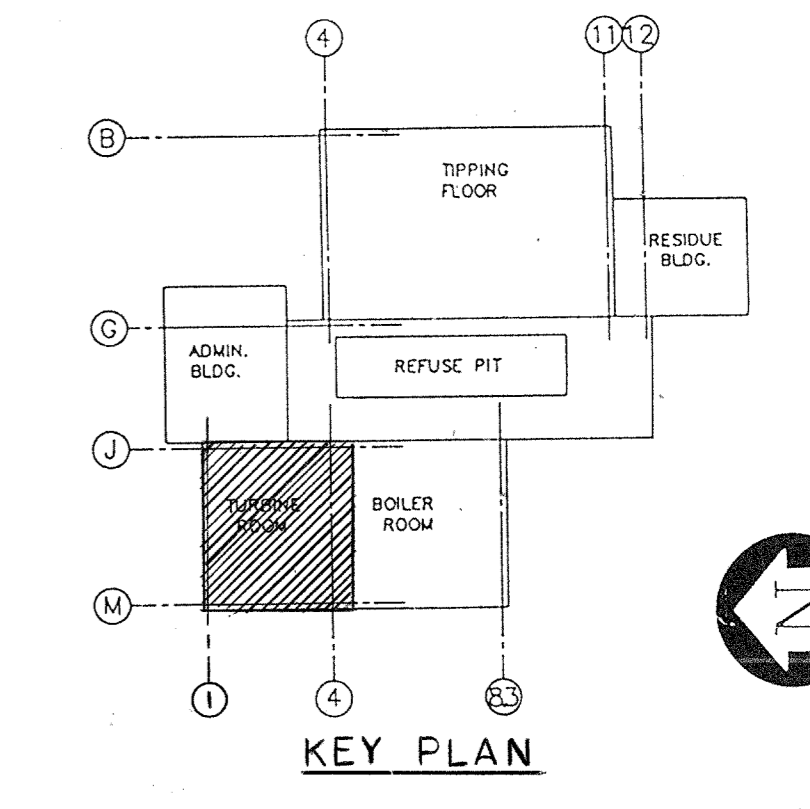

OGDEN MARTIN SYSTEMS OF KENT, INC.
GENERAL ARRANGEMENT
 ENLARGED PLAN EL. 116'-0" EL. 125'-0"
 KENT COUNTY RESOURCE RECOVERY FACILITY

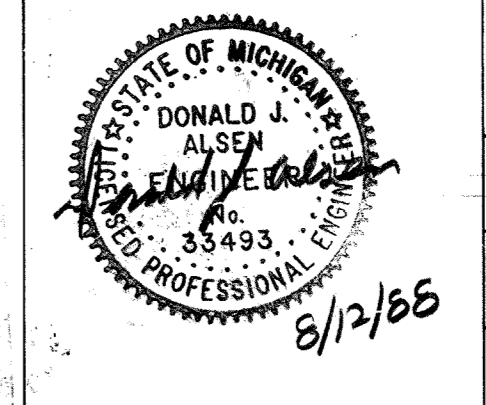

Engineering Design Services, Inc.	
DRAWN: A.A.M.	DATE: 10-1-87
DESIGNED: N.M.T.	DATE: 8/11/88
CHECKED: T.M.A.	DATE: 8/11/88
PROJECT NO: 8712325	SCALE: 1/4"=1'-0"
APPROVED: D.J.A.	DATE: 8/12/88
DRAWING NO: 12325-M206	SHT. OF REV: 1

COMPANY CONFIDENTIAL
 THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF OGDEN MARTIN SYSTEMS OF KENT, INC. AND ARE NOT TO BE USED EXCEPT AS EXPRESSLY AUTHORIZED IN WRITING BY SAID COMPANY.